


TRANS



LRD-609SA series

Line Voltage SmartDIM Occupancy Sensor

INSTALLATION INSTRUCTIONS

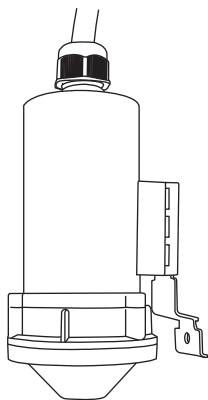

w/Lens A/B/C

*More lens options are available for this sensor. Please refer to the Lens Datasheet for more details.

APPLICABLE REMOTE (order separately)

| Model | Description | Remarks |
|---------|-------------------------|------------------------------------|
| SRP-280 | TRANS Remote Programmer | Full functionality |
| URP-100 | User Remote | Manual ON/OFF/DIM TIME/LUX setting |

⚠ WARNING & CAUTION

- Risk of Electric Shock - Disconnect power supply before servicing.
- Do NOT touch the square window of infrared sensor under the lens assembly.
- Open Type Photoelectric Switches.
- Cycling the power to the sensors will cause failure over time.

⚠ AVERTISSEMENT & PRUDENCE

- Risque de choc électrique - Débranchez l'alimentation avant l'entretien.
- Ne PAS toucher la fenêtre carrée de capteur infrarouge sous l'ensemble de l'objectif.
- Ouvrir Type commutateurs optoélectroniques.

OVERVIEW


The LRD-609SA series member of the TRANS family is a two-way IR remote programmable line voltage switching occupancy sensor with 0-10V output for dimmable ballast or LED driver control. The sensor is capable of providing top-notch energy efficient lighting control in multiple modes with fully programmable multi-level high/low dim or SmartDIM control. SmartDIM is a state-of-the-art automatic dimming control technology developed by IR-TEC, which is capable of maintaining the overall ambient light level within the preset range through a smooth, flawless continuous dimming control to the connected lighting.

The sensor will turn on the connected lighting to the high dim or SmartDIM level as programmed when it detects the presence of an occupant or vehicle, and automatically dim the light down to the low level or shut off as programmed after the area is vacated for a period of time. An exclusive two-way handheld remote programmer (SRP-280) allows you to configure sensor setting, or download the existing settings of the installed sensor from the floor. In addition, an exclusive Hybrid Switching technology makes the LRD-609 series perfect sensor to control a group of LED lightings with exceptionally high inrush current (HIC) while switching on.

Like all PIR sensors of TRANS family, LRD-609SA series is available with interchangeable lenses. The sensor comes with an universal mounting design which provides complete installation flexibility. The sensor is designed to operate in the coldest of environments, down to -40°C/°F.

APPLICATION NOTES


1. The sensor is more sensitive to the movements "crossing" the detection zones than "toward" or "away" the sensor unit. To obtain better sensitivity, avoid placing the sensor in line with occupant path, if possible.
2. The closer the movement is to the sensor, the more sensitive the sensor is. The higher the sensor is installed, the larger movement is required to be detected.
3. Ensure to place the sensor at least at 1.5m (5 ft.) away from air supply ducts as rapid air flow may cause false activations.
4. The sensor cannot "see" the movements behind obstacles, such as furniture, shelf, glass or partition. As a general rule, each occupant should be able to clearly view the sensor unit.
5. For open office areas with partition which could block the sensor view to occupant movements, it is best to place the sensors over the intersection of multiple workstations. For large areas of open office or space, place multiple sensors so that there is overlap coverage with each adjacent sensor.

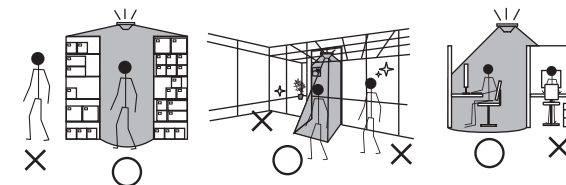

LENS OPTIONS

Different lenses can be applied to provide specific coverage at different mounting heights. Please refer to the lens datasheet attached for more details.

SENSOR MOUNTING

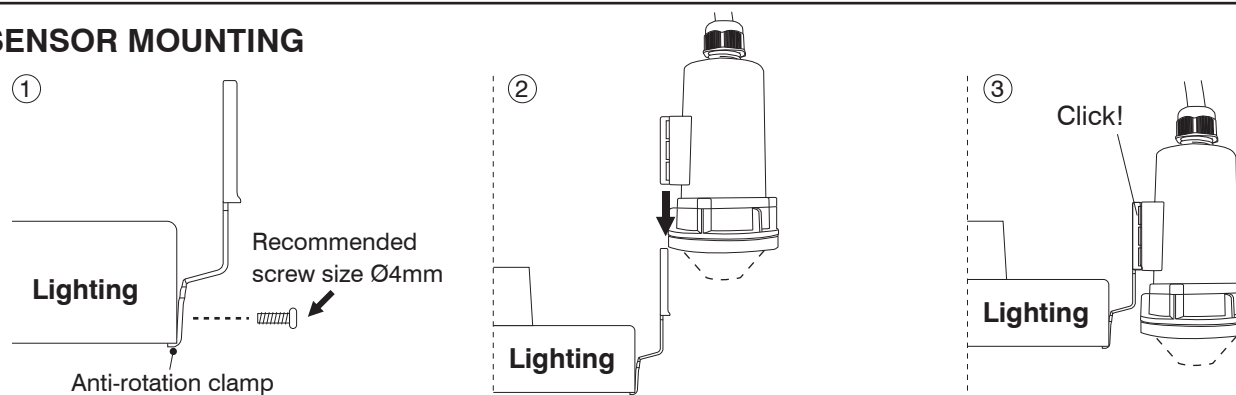

www.irtec.com

P/N: 058-60910-003

Printed in Taiwan

This product may be covered by one or more U.S. patents or patent applications. Please visit www.irtec.com for more information.



CONTROL MODE

The LRD-609SA sensor can be programmed by SRP-280 remote programmer to control the lighting in one of the following modes. For more details of specific control scheme, please visit www.irtec.com or contact an IR-TEC team member directly.

ON/OFF : ON-OFF Switching

OSO : Occupancy Sensing Only

OSLA : Occupancy Sensing at Low Ambient

OSLATO : Occupancy Sensing at Low Ambient with Time-Off

OFF : Light OFF all the time

| Mode | Control |
|--------|--|
| ON/OFF | 1. While ambient lux is higher than the level set, light stays OFF . 2. While ambient lux is lower than the level set, and occupancy detected , switch the light to HIGH DIM . 3. Turn OFF the light after occupant leave and delay time elapses. |
| OSO | 1. Ambient light sensor disabled. 2. Dim the light to LOW DIM at all time under vacancy. 3. Switch the light to HIGH DIM under occupancy. 4. Dim the light to LOW DIM after occupant leave and delay time elapses. |
| OSLA | 1. While ambient lux is higher than the level set, light stays OFF . 2. While ambient lux is lower than the level set, dim the light to LOW DIM under vacancy. 3. While ambient lux is lower than the level set, and occupancy detected , switch the light to HIGH DIM 4. Dim the light to LOW DIM after occupant leave and delay time elapses. |
| OSLATO | 1. While ambient lux is higher than the level set, light stays OFF . 2. While ambient lux is lower than the level set, and occupancy detected , switch the light to HIGH DIM . 3. Dim the light to LOW DIM after occupant leave and delay time elapses. 4. Turn OFF the lights when TIME OFF delay elapses. 5. When occupancy detected during TIME OFF , switch the light to HIGH DIM . |
| OFF | 1. All lighting controlled by the sensor will remain OFF until another mode is selected. |

SENSOR ACKNOWLEDGMENT

| Acknowledgement | Sensor LED | Beep | Lighting |
|--------------------------------------|------------|-----------------------|-----------|
| Full sensor setting upload completed | - | Long x 1 Short x 2 | Flash x 2 |
| Sensor resume to factory default | - | - | Flash x 2 |
| SmartDIM level set completed | - | Short x 2 | Flash x 2 |
| Single setting ok | - | Short x 2 | - |
| Occupancy detected | Flash x 1 | - | - |


SENSOR SETTINGS

The followings are settings and options available with LRD-609SA that can be configured through the operation of SRP-280 remote programmer. For more details of remote sensor setting, please refer to the operation instruction of SRP-280.


| Settings | Description | Options | Default |
|-------------------------|---|---------------------------------------|----------|
| CONTROL | The mode that the sensor will control. | ON/OFF, OSO, OSLA, OSLATO, OFF | OSLATO |
| AMBIENT LUX | The ambient light level that sensor will perform the control. | 10/20/40/60/100/200/400 LUX/DISABLED | DISABLED |
| DELAY | The delay time that sensor is set to turn off or dim the light. | 30 sec./1/3/5/10/15/20/30/60 min. | 10 min. |
| TIME OFF | The delay time that sensor will keep the light at low dim level after the OFF delay time elapsed. Only available if OSLATO is selected. | 10/30 sec./3/5/10/15/20/30/45/60 min. | 10 min. |
| HIGH DIM | The output level set to control the light during occupancy. | 50/55/60/65/70/80/90/100%/SmartDIM | 100% |
| LOW DIM/SmartDIM | The output level set to dim the light when space is vacant for bi-level control. Low dim setting will become SmartDIM bar if SmartDIM control is selected. | 0/5/10/15/20/25/30/40% | 30% |
| RAMP UP | The speed of increasing the lighting output to HIGH DIM level. | INSTANT/SOFT/SLOW | INSTANT |
| FADE DOWN | The speed of decreasing the lighting output to LOW DIM level or off. | INSTANT/SOFT/SLOW | SOFT |
| LED INDICATOR | Enable/disable the LED indicator of sensor. | ENABLED/DISABLED | ENABLED |
| SENSITIVITY | The sensitivity of occupancy sensor. | HIGH/NORMAL/LOW | HIGH |
| MIN. DIM | The lowest dim level applicable on the sensor. | 12%/15%/DISABLED | DISABLED |
| DAY O'RIDE | Enable/disable daylight override control. Sensor will shut off the light when ambient lux exceeds the override level set below. Only available if AMBIENT LUX is enabled. | ENABLED/DISABLED | DISABLED |
| O'RIDE LEVEL | The ambient lux level to enable daylight override. Only available if DAY O'RIDE is enabled. | HIGH(~1.8X)/NORMAL(~1.5X)/LOW(~1.3X) | NORMAL |

WIRING DIAGRAM

Non-dimmable Lighting (ON/OFF Switching only)

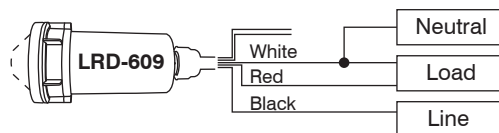

0-10V Dimmable Lighting

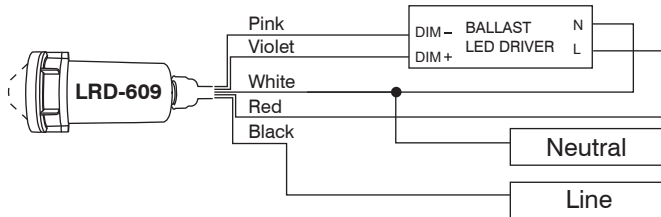

NOTE:

1. The driver/ballast **MUST** be 0-10V dimmable to achieve dimming control.
2. Ensure connection of LINE and NEUTRAL are not reversed to avoid damaging the sensor.
3. Ensure TOTAL isolation between DIM+ /DIM- and GROUND to avoid damaging the sensor.
4. Conduct test with GROUND connected.

SPECIFICATIONS

| | | | |
|--|---|--------|----------------|
| Power supply | 100/120/230/277VAC, 50/60 Hz | | |
| Maximum load | 100-120VAC | 230VAC | 277VAC |
| -Incandescent/Halogen | 800/*500W(VA) | 5A | 1200/*750W(VA) |
| -Fluorescent Ballast/CFL | 800/*500W(VA) | 5A | 1200/*750W(VA) |
| -Ballast Electronic (LED) | 540/*500VA | 5A | 1200/*750VA |
| Infrared sensor | Omni-directional pyroelectric | | |
| Photo sensor | Digital ambient light sensor | | |
| HIC protection | Max. 80A for 16.7msec. | | |
| Dim control output | 0-10V, $\pm 5\%$, isolated, max. 25 mA | | |
| Detectable speed | 0.3 ~ 3 m/sec. (1~10 ft./sec.) | | |
| Mounting height | Subject to the lens type applied | | |
| Detection range | Subject to the lens type applide and height | | |
| Remote range | 10 m (33 ft.) indoor, no backlight | | |
| Op. humidity | Max. 95% RH | | |
| Op. temperature | -40°C~60°C (-40°F~140°F) | | |
| Dimensions | L65 x W73 x H131mm (L2.56" x W2.87" x H5.16") | | |
| *Max load for operating temperature at 55°C~60°C (131°F~140°F) | | | |