


# TRANS



## LRD-309S

Line Voltage SmartDIM Occupancy Sensor

## INSTALLATION INSTRUCTIONS

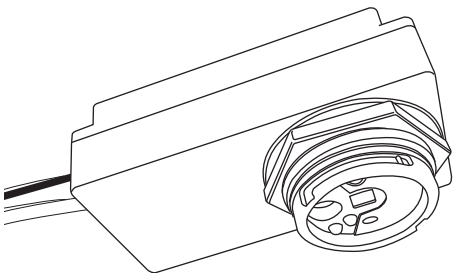

\*This sensor requires lens. Please order separately.  
Refer to the Lens Datasheet for more details.

### APPLICABLE REMOTE (order separately)

Model	Description	Remarks
SRP-280	TRANS Remote Programmer	Full functionality
URP-100	User Remote	Manual ON/OFF/DIM TIME/LUX setting

### WARNING & CAUTION

- Risk of Electric Shock - Disconnect power supply before servicing.
- Do NOT touch the square window of infrared sensor under the lens assembly.
- Open Type Photoelectric Switches.
- Cycling the power to the sensors will cause failure over time.

### AVERTISSEMENT & PRUDENCE


- Risque de choc électrique - Débranchez l'alimentation avant l'entretien.
- Ne PAS toucher la fenêtre carrée de capteur infrarouge sous l'ensemble de l'objectif.
- Ouvrir Type commutateurs optoélectroniques.

## INTRODUCTION

The LRD-309S is a low-profile, fixture integrated occupancy sensor designed to control 0-10V dimmable or non-dimmable ballasts and LED drivers. This 2-way, remote-programmable sensor is capable of providing four different occupancy sensing control schemes with fully adjustable multi-level high/low StepDIM or SmartDIM control to the integrated fixtures. **SmartDIM** is a state-of-the-art automatic dimming control technology developed by IR-TEC, which enables the sensor to maintain the overall ambient light level within the preset range through a smooth, flawless continuous dimming control to the connected lighting. The LRD-309S also employs an exclusive Hybrid Switching technology to allow switching the LED driver with high inrush current, up to 500,000 cycles.


The sensor will turn on the integrated lighting or ramp up to the programmed high dim or SmartDIM level when it detects the presence of an occupant or vehicle, and automatically dim the light down to the low level or shut off after the area is vacated for a period of time. The sensor can be operating even in the coldest of environments down to -40°C/°F. A two-way IR handheld remote programmer (SRP-280) allows you to easily configure sensor control schemes and settings, or download the existing settings of the sensor from the floor. Four EZ-SET profiles can be stored in the SRP-280 for quick setup and parameter adjustment of multiple sensors.

## DIMENSIONS

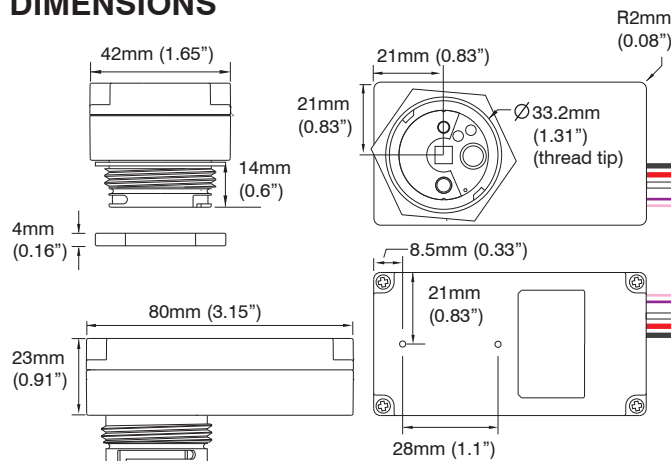


## APPLICATION NOTES

1. The sensor is more sensitive to the movements “crossing” the detection zones than “toward” or “away” the sensor unit. To obtain better sensitivity, avoid placing the sensor in line with occupant path, if possible.
2. The closer the movement is to the sensor, the more sensitive the sensor is. The higher the sensor is installed, the larger movement is required for detection. The warmer the room is, the harder the sensor to detect the movement.
3. Ensure to place the sensor at least at 1.5m (5 ft.) away from air supply ducts as rapid air flow may cause false detections.
4. Avoid placing the sensor where obstructions may block the sensor's line of sight. PIR sensor cannot detect movements through glass.

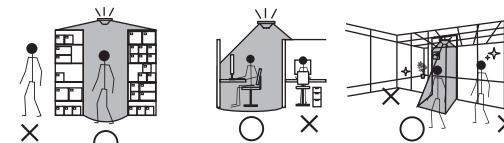

## MOUNTING

The sensor can be integrated with lighting fixture through a round hole with 34mm (1.34\") diameter.

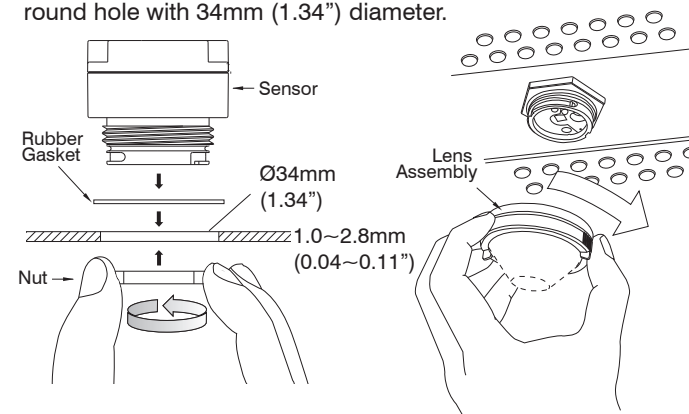

## LENS OPTIONS

Different lenses can be applied to provide specific coverage at different mounting heights. Please refer to the lens datasheet for more details.



www.irtec.com

P/N: 058-30903-006

Printed in Taiwan

This product may be covered by one or more U.S. patents or patent applications.  
Please visit [www.irtec.com](http://www.irtec.com) for more information.



## CONTROL MODE

The LRD-309S sensor can be programmed to control the lighting in one of the following modes via a SRP-280 remote programmer. For more details of specific control mode, please visit [www.irtec.com](http://www.irtec.com) or contact an IR-TEC team member directly.

**ON/OFF** : ON-OFF Switching

**OSO** : Occupancy Sensing Only

**OSLA** : Occupancy Sensing at Low Ambient

**OSLATO** : Occupancy Sensing at Low Ambient with Time-Off

**OFF** : Light OFF all the time

Mode	Control
ON/OFF	1. While ambient lux is <b>higher</b> than the level set, light stays <b>OFF</b> . 2. While ambient lux is <b>lower</b> than the level set, and <b>occupancy detected</b> , switch the light to <b>HIGH DIM</b> . 3. Turn <b>OFF</b> the light after occupant leave and delay time elapses.
OSO	1. Ambient light sensor disabled. 2. Dim the light to <b>LOW DIM</b> at <b>all time</b> under vacancy. 3. Switch the light to <b>HIGH DIM</b> under occupancy. 4. Dim the light to <b>LOW DIM</b> after occupant leave and delay time elapses.
OSLA	1. While ambient lux is <b>higher</b> than the level set, light stays <b>OFF</b> . 2. While ambient lux is <b>lower</b> than the level set, dim the light to <b>LOW DIM</b> under vacancy. 3. While ambient lux is <b>lower</b> than the level set, and <b>occupancy detected</b> , switch the light to <b>HIGH DIM</b> . 4. Dim the light to <b>LOW DIM</b> after occupant leave and delay time elapses.
OSLATO	1. While ambient lux is <b>higher</b> than the level set, light stays <b>OFF</b> . 2. While ambient lux is <b>lower</b> than the level set, and <b>occupancy detected</b> , switch the light to <b>HIGH DIM</b> . 3. Dim the light to <b>LOW DIM</b> after occupant leave and delay time elapses. 4. Turn <b>OFF</b> the lights when <b>TIME OFF</b> delay elapses. 5. When <b>occupancy detected</b> during <b>TIME OFF</b> , switch the light to <b>HIGH DIM</b> .
OFF	1. All lighting controlled by the sensor will remain <b>OFF</b> until another mode is selected.

## SENSOR ACKNOWLEDGMENT

Acknowledgement	Sensor LED	Beep	Lighting
Full sensor setting upload completed	-	Long x 1 Short x 2	Flash x 2
Sensor resume to factory default	-	-	Flash x 2
SmartDIM level set completed	-	Short x 2	Flash x 2
Single setting ok	-	Short x 2	-
Occupancy detected	Flash x 1	-	-


## SENSOR SETTINGS

The followings are settings and options available with LRD-309S that can be configured via SRP-280 remote programmer. For more details of remote operation, please refer to the operation instruction of SRP-280.


Settings	Description	Options	Default
<b>CONTROL</b>	The mode that the sensor will control.	ON/OFF, OSO, OSLA, OSLATO, OFF	OSLATO
<b>AMBIENT LUX</b>	The ambient light level that sensor will perform the control.	10/20/40/60/100/200/400 LUX/DISABLED	DISABLED
<b>DELAY</b>	The delay time that sensor is set to turn off or dim the light.	30 sec./1/3/5/10/15/20/30/60 min.	10 min.
<b>TIME OFF</b>	The delay time that sensor will keep the light at low dim level after the OFF delay time elapsed. Only available if OSLATO is selected.	10/30 sec./3/5/10/15/20/30/45/60 min.	10 min.
<b>HIGH DIM</b>	The output level set to control the light during occupancy.	50/55/60/65/70/80/90/100%/SmartDIM	100%
<b>LOW DIM/SmartDIM</b>	The output level set to dim the light when space is vacant for bi-level control. Low dim setting will become SmartDIM bar if SmartDIM control is selected.	0/5/10/15/20/25/30/40%	30%
<b>RAMP UP</b>	The speed of increasing the lighting output to HIGH DIM level.	INSTANT/SOFT/SLOW	INSTANT
<b>FADE DOWN</b>	The speed of decreasing the lighting output to LOW DIM level or off.	INSTANT/SOFT/SLOW	SOFT
<b>LED INDICATOR</b>	Enable/disable the LED indicator of sensor.	ENABLED/DISABLED	ENABLED
<b>SENSITIVITY</b>	The sensitivity of occupancy sensor.	HIGH/NORMAL/LOW	HIGH
<b>MIN. DIM</b>	The lowest dim level applicable on the sensor.	12%/15%/DISABLED	DISABLED
<b>DAY O'RIDE</b>	Enable/disable daylight override control. Sensor will shut off the light when ambient lux exceeds the override level set below. Only available if AMBIENT LUX is enabled.	ENABLED/DISABLED	DISABLED
<b>O'RIDE LEVEL</b>	The ambient lux level to enable daylight override. Only available if DAY O'RIDE is enabled.	HIGH(~1.8X)/NORMAL(~1.5X)/LOW(~1.3X)	NORMAL

## WIRING DIAGRAM

### Non-dimmable Lighting (ON-OFF Switching only)

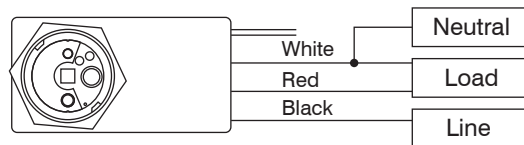

### 0-10V Dimmable Lighting

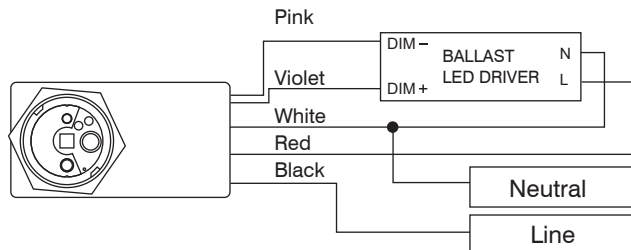

#### NOTE:

1. The driver/ballast **MUST** be 0-10V dimmable to achieve dimming control.
2. Ensure connection of LINE and NEUTRAL are not reversed to avoid damaging the sensor.
3. Ensure TOTAL isolation between DIM+/DIM- and GROUND to avoid damaging the sensor.
4. Conduct test with GROUND connected.

## SPECIFICATIONS

Power supply	100/120/277VAC, 50/60 Hz	
Maximum load	100-120VAC	277VAC
-Incandescent/Halogen	800/*500W(VA)	1200/*750W(VA)
-Fluorescent Ballast/CFL	800/*500W(VA)	1200/*750W(VA)
-Ballast Electronic (LED)	540/*500VA	1200/*750VA
Infrared sensor	Digital pyroelectric sensor	
Photo sensor	Digital ambient light sensor	
HIC protection	Max. 80A for 16.7msec.	
Dim control output	0-10V, $\pm 5\%$ , isolated, max. 25mA	
Detectable speed	0.3 ~ 3 m/sec. (1~10 ft./sec.)	
Mounting height	Subject to the lens type applied	
Detection range	Subject to the lens type and mounting height	
Remote range	10 m (33 ft.) indoor, no backlight	
Op. humidity	Max. 95% RH	
Op. temperature	-40°C~70°C (-40°F~158°F)	
Dimensions	80x42x37mm (3.15"x1.65"x1.46")	
*Max load for operating temperature at 55°C~70°C (131°F~158°F)		